

GEOTECHNICAL EVALUATION REPORT

SIERRA VISTA TRACTS A, E & F

New Mexico Highway 6
Los Lunas, New Mexico
WT Reference No. 3229JJ104

PREPARED FOR:

Sierra Vista Los Lunas, LLC
3211 Highway 47
Los Lunas, New Mexico 87031
Attn: Bob Prewitt

December 18, 2019



Kyel Newberry, E.I.
Project Engineer



Jeff M. Boyd, P.E.
Senior Geotechnical Engineer



TABLE OF CONTENTS

1.0	PURPOSE	1
2.0	PROJECT DESCRIPTION	1
3.0	SCOPE OF SERVICES	2
3.1	Field Exploration	2
3.2	Laboratory Analysis.....	2
3.3	Analyses and Report	2
4.0	SITE CONDITIONS	3
4.1	Surface	3
4.2	Subsurface	3
5.0	GEOTECHNICAL PROPERTIES & ANALYSIS	3
5.1	Laboratory Tests	3
5.2	Field Tests	3
6.0	RECOMMENDATIONS	4
6.1	General	4
6.3	Foundations	4
6.4	Lateral Design Criteria	5
6.5	Seismic Considerations	6
6.6	Conventional Slab-on-Grade Support.....	6
6.7	Drainage.....	7
6.8	Pavements	7
7.0	EARTHWORK	8
7.1	General	8
7.2	Site Clearing	8
7.3	Building Pad Preparation	8
7.4	Pavement Preparation.....	9
7.5	Materials	9
7.6	Placement and Compaction.....	9
7.7	Cut and Fill Slopes.....	10
7.8	Gound Compaction and Shrinkage Factors	11
7.9	Compliance	11
8.0	LIMITATIONS	11
9.0	CLOSURE	12
	BORING LOCATION DIAGRAM	Plate 1



APPENDIX A

Definition of Terminology A-1
Method of Soil Classification A-2
Boring Log Notes A-3
Boring Logs A-4 thru A-63

APPENDIX B

Laboratory Tests B-1 thru B-6

APPENDIX C

Shear Wave Velocity Profiles C-1 thru C-8



**GEOTECHNICAL EVALUATION
SIERRA VISTA – TRACTS A, E & F
NEW MEXICO HIGHWAY 6
LOS LUNAS, NEW MEXICO
WT JOB NO. 3228JJ104**

1.0 PURPOSE

This report contains the results of our geotechnical evaluation for the proposed residential subdivision, and was performed in general accordance with our contract. The purpose of our services is to provide information and recommendations regarding:

- Subsurface conditions
- Foundation design parameters
- Lateral earth pressures
- Seismic considerations
- Slabs-on-grade
- Drainage
- Corrosivity
- Pavements
- Excavation conditions
- Earthwork, including site preparation, fill placement, and suitability of existing soils for fill materials, and compaction
- Cut and fill slopes

Results of the field exploration, field and laboratory tests are presented in the Appendices.

2.0 PROJECT DESCRIPTION

We understand that the project will consist of development of the site as a single-family residential subdivision. There will be approximately 725 lots, and the homes will be one and two story wood-frame structures with a slab-on-grade floor and stucco veneer. Maximum wall and column loads are assumed to be 2.5 klf and 35 kips, respectively. We anticipate no extraordinary slab-on-grade criteria and that the ground floor level will be at or slightly above existing site grades. It is our understanding that cuts of about 45 feet and fills of up to 15 feet will be required in order to achieve final grades. Should any of our information or assumptions not be correct, the Client will notify WT immediately.



3.0 SCOPE OF SERVICES

3.1 Field Exploration

Sixty borings were drilled to depths ranging from 21.5 to 41.5 feet below existing grade in the proposed building areas. In addition, eight Seismic Refraction Micro-Tremor Surveys (Re-Mi) were performed. The borings and seismic surveys were performed at the approximate locations shown on the attached Boring Location Diagram. A field log was prepared for each boring. These logs contain visual classifications of the materials encountered during drilling as well as interpolation of the subsurface conditions between samples. Final logs, included in Appendix A, represent our interpretation of the field logs and may include modifications based on laboratory observations and tests of the field samples. The final logs describe the materials encountered, their thicknesses, and the locations where samples were obtained.

The Unified Soil Classification System was used to classify soils. The soil classification symbols appear on the boring logs and are briefly described in Appendix A. Local and regional geologic characteristics were used to estimate the seismic design criteria.

3.2 Laboratory Analysis

Laboratory analyses were performed on representative soil samples to aid in material classification and to estimate pertinent engineering properties of the on-site soils for preparation of this report. The following tests were performed in general accordance with applicable procedures, and the results are presented in Appendix B.

- Field moisture content
- In-situ soil density
- -#200 Sieve
- Liquid limit and plasticity index
- Compression

3.3 Analyses and Report

Analyses were performed and this report was prepared for the exclusive purpose of providing geotechnical engineering and/or testing information and recommendations. The scope of services for this project does not include, either specifically or by implication, any environmental assessment of the Site or identification of contaminated or hazardous materials or conditions. If the owner is concerned about the potential for such



contamination, other studies should be undertaken. We are available to discuss the scope of such studies with you.

This geotechnical engineering report includes a description of the project, a discussion of the field and laboratory testing programs, a discussion of the subsurface conditions, and design recommendations as required to satisfy the purpose previously described.

4.0 SITE CONDITIONS

4.1 Surface

At the time of our exploration, the Site was undeveloped. The ground surface contained a moderate growth of native grass and shrubs. The northern portion of the site slopes down gently to the north, with the southern portion of the site consisting of a hill side sloping to the north.

4.2 Subsurface

As presented on the boring logs, site soils within the depths explored consisted of loose to very dense poorly graded SAND with silt and Silty SAND. Near surface soils are of non-plastic. Groundwater was not encountered in any of the borings at the time of exploration.

5.0 GEOTECHNICAL PROPERTIES & ANALYSIS

5.1 Laboratory Tests

Laboratory test results (see Appendix B) indicate that native subsoils exhibit slight compressibility at existing water contents. Low to moderate amounts of additional compression occurs when the water content is increased.

Near-surface soils are non-plastic to low plasticity. These soils are not expected to exhibit significant shrink/swell upon changes in moisture content.

5.2 Field Tests

Eight Seismic Refraction Micro-Tremor Surveys (Re-Mi) were performed to evaluate the shear wave velocity profiles.



Two Re-Mi surveys were performed, in a prior report, just to the east of the site, in an area of known deep hydrocollapse. The purpose of these surveys was to compare the shear wave velocity profiles, and correlate with modulus values, in order to determine potential compressibility and/or collapse potential. Based upon the Re-Mi surveys, the site has approximately 20 percent higher shear wave velocity profiles versus the area to the east.

6.0 RECOMMENDATIONS

6.1 General

Recommendations contained in this report are based on our understanding of the project criteria described in **Section 2.0**, and the assumption that the soil and subsurface conditions are those disclosed by the borings. Others may change the plans, final elevations, number and type of structures, foundation loads, and floor levels during design or construction. Substantially different subsurface conditions from those described herein may be encountered or become known. Any changes in the project criteria or subsurface conditions shall be brought to our attention in writing.

6.3 Foundations

Conventional spread-type footings may be used to support the proposed homes. Since the native soils exhibit some hydrocollapse settlement potential, the footings should bear on engineered fills achieved by removal and recompaction of the soils below footings. Where cuts are deeper than 15 feet, foundations may bear on undisturbed native soils. The depth and lateral extent of the engineered fills is presented in the **Earthwork** section of this report. The following tabulation may be utilized to proportion the foundations:

Footing Depth Below Finished Grade (ft.) ¹	Allowable Bearing Capacity (psf) ²
1.5 ³	2,000
2.0	2,500

¹ Finished grade is the lowest adjacent grade for perimeter footings and floor level for interior footings.

² Allowable bearing capacities assume fulfillment of **EARTHWORK** recommendations.

³ Minimum depth for frost protection for exterior footings or footings in unheated spaces.

Building clearances should be in accordance with 2015 IBC Section 1808.7. In general, foundations adjacent to slopes, a minimum horizontal setback of five feet should be



maintained between the foundation base and slope face. In addition, the setback should be such that an imaginary line extending downward at 45 degrees from the nearest foundation edge does not intersect the slope.

We anticipate that differential movement of the proposed homes, supported as recommended, should be $\frac{3}{4}$ of one inch or less. Additional foundation movements could occur if water from any source infiltrates the foundation soils. Therefore, proper drainage should be provided in the final design and during construction.

All footings, stem walls, and masonry walls should be reinforced to reduce the potential for distress caused by differential foundation movements. The use of joints at openings or other discontinuities in masonry walls is recommended.

We recommend that the geotechnical engineer or his representative observe the footing excavations before reinforcing steel and concrete are placed. This observation is to assess whether the soils exposed are similar to those anticipated for support of the footings. Any soft, loose or unacceptable soils should be undercut to suitable materials and backfilled with approved fill materials or lean concrete. Soil backfill should be properly compacted.

6.4 Lateral Design Criteria

Earth retaining structures above any free water surface, and no surcharge loads may be designed using the equivalent fluid pressure method. Recommended equivalent fluid pressures and coefficients of base friction are:

- Active:
 - Level Backfill35 psf/ft
 - 3H:1V Backfill.....50 psf/ft
 - 2H:1V Backfill.....62 psf/ft
- Passive:
 - Shallow wall footings.....250 psf/ft
 - Shallow column footings400 psf/ft
- Coefficient of base friction 0.4*

*The coefficient of base friction should be reduced to 0.3 when used in conjunction with passive pressure.

The lateral earth pressures presented herein do not include the lateral pressures arising from the presence of:



- Hydrostatic conditions, submergence or partial submergence
- Surcharge loading, permanent or temporary
- Seismic or dynamic conditions

Fill against footings, stem walls, and retaining walls should be compacted to densities specified in **EARTHWORK**. Compaction of each lift adjacent to walls should be accomplished with hand-operated tampers or other lightweight compactors. Over-compaction may cause excessive lateral earth pressures that could result in wall movements.

6.5 Seismic Considerations

For structural designs based upon the 2012/2015 International Building Code, the following criteria will apply. The soil site class is C. S_s , the spectral acceleration for short periods, is 0.437g. S_1 , the spectral acceleration for a 1-second period, is 0.128g. F_a and F_v , are 1.2 and 1.672, respectively.

6.6 Conventional Slab-on-Grade Support

Interior slabs-on-grade can be supported on properly placed and compacted fill or approved natural soils. The slab subgrade should be prepared by the procedures outlined in this report. A four-inch layer of base course is desirable beneath all slabs to help prevent capillary rise and a damp slab. Final determination of the use of base course should be left to the slab designer.

The use of vapor retarders is desirable for any slab-on-grade where the floor will be covered by products using water based adhesives, wood, vinyl backed carpet, impermeable floor coatings (urethane, epoxy, acrylic terrazzo, etc.) or where the floor will be in contact with moisture sensitive equipment or product. When used, the design and installation should be in accordance with the recommendation given in ACI 302.1R and 302.2R (most recent versions). Final determination on the use of a vapor retarder should be left to the slab designer.

All concrete placement and curing operations should follow the American Concrete Institute manual recommendations. Improper curing techniques and/or high slump (high water-cement ratio) could cause excessive shrinkage, cracking or curling. Concrete slabs should be allowed to cure adequately before placing vinyl or other moisture sensitive floor covering.



6.7 Drainage

The major cause of soil problems in this vicinity is moisture increase in soils below structures. Therefore, it is extremely important that positive drainage be provided subdivision. Infiltration of water into utility or foundation excavations must be prevented during construction. Planters or other surface features that could retain water adjacent to the homes should be limited to "Xeriscape" type landscaping with minimal irrigation. It is very important that proper planning and control of any landscape and irrigation practices be performed.

In areas where sidewalks, patios, or other hardscaped flatwork do not immediately adjoin the homes, protective slopes should be provided with a positive (as high as practical) outfall away from the homes. Splash pads, scuppers and drainpipes should be designed to provide drainage away from the structure for a minimum of 10 feet. Backfill against footings, exterior walls, and in utility and sprinkler line trenches should be well compacted and free of all construction debris to minimize the possibility of moisture infiltration.

6.8 Pavements

The on-site soils are considered as good quality materials for support of pavements. The types of traffic anticipated to use the subdivision include passenger vehicles and small to medium size trucks, occasional moving trucks, and garbage trucks. On this basis, a daily traffic value of five Equivalent 18-kip Single Axle Loads (ESAL) was estimated. A resilient modulus (M_r) of 15,000 pounds per square inch was assigned to the on-site soil. A reliability value of 80 percent was assigned to the facility that corresponds to occasional interruption of traffic for pavement repairs. Based upon these parameters, the resulting pavement sections according to the AASHTO procedure for a 20-year design life is 2.5 inches of asphalt concrete over 4 inches of aggregate base course.

The "design life" of a pavement is defined as the expected life at the end of which reconstruction of the pavement will need to occur. Normal maintenance, including crack sealing, slurry sealing, and/or chip sealing, should be performed during the life of the pavement.

Bituminous surfacing should be constructed of dense-graded, central plant-mix, asphalt concrete. Base course, portland cement, and asphalt concrete should conform with New Mexico Department of Transportation (NMDOT) or Village of Los Lunas specifications.



Material and compaction requirements should conform to recommendations presented in the **Earthwork** section of this report. The gradient of paved surfaces should ensure positive drainage. Water should not pond in areas directly adjoining paved sections.

7.0 EARTHWORK

7.1 General

The conclusions contained in this report for the proposed construction are contingent upon compliance with recommendations presented in this section. Any excavating, trenching, or disturbance that occurs after completion of the earthwork must be backfilled, compacted and tested in accordance with the recommendations contained herein. It is not reasonable to rely upon our conclusions and recommendations if any future unobserved and untested trenching, earthwork activities or backfilling occurs.

7.2 Site Clearing

Strip and remove any existing vegetation, organic topsoils, debris, and any other deleterious materials from the building and pavement areas. The building area is defined as that area within the building footprint plus five feet beyond the perimeter of the footprint. All exposed surfaces should be free of mounds and depressions that could prevent uniform compaction.

Sloping areas steeper than 5:1 (horizontal:vertical) should be benched to reduce the potential for slippage between existing slopes and fills. Benches should be level and wide enough to accommodate compaction and earth moving equipment.

7.3 Building Pad Preparation

Where the entire building will be located either on at least 5 feet of fill, or in at least 15 feet of cut, no additional building pad preparation is required. Prior to the placement of fill, or after cutting to design elevation, the exposed soil should be scarified a minimum depth of 10 inches, moistened or dried as required, and recompactd as recommended herein.

In building pads where there is less than 5 feet of fill, or in a transition between cut and fill, remove existing soil to a minimum depth of 5 feet below finished pad elevation. The exposed soil should be scarified a minimum depth of 10 inches, moistened or dried as required, and recompactd as recommended herein.



7.4 Pavement Preparation

The subgrade should be scarified, moistened as required, and recompactd for a minimum depth of 10 inches prior to placement of fill and pavement materials.

7.5 Materials

Clean on-site native soils with low-expansive potentials or imported materials may be used as fill material for the following:

- Foundation areas
- Interior slab areas
- Pavement areas
- Backfill

Imported soils should conform to the following:

- Gradation (ASTM C136):

	percent finer by weight
6"	100
4"	85-100
¾"	70-100
No. 4 Sieve	50-100
No. 200 Sieve	15 (max)
- Maximum soluble sulfates (%)..... 0.10
- Maximum Plasticity Index (PI) Non-Plastic

Base course should conform to the Village of Los Lunas or NMDOT specifications.

7.6 Placement and Compaction

- a. Place and compact fill in horizontal lifts, using equipment and procedures that will produce recommended water contents and densities throughout the lift.
- b. Uncompacted fill lifts should not exceed 10 inches.
- c. Frozen soil should not be used as fill and no fill should be placed over frozen ground.



d. Materials should be compacted to the following:

**Minimum Percent
Material Compaction (ASTM D1557)**

- On-site soil/imported soil, reworked and fill (fills >5 feet in thickness).....98
- On-Site soil/imported soil, reworked and fill (fills </= 5 feet in thickness).....95
- Aggregate base course below slabs-on-grade.....95
- Aggregate base below pavement 100
- Nonstructural backfill.....90

On-site and imported soils should be compacted within a water content range of optimum to 4 percent above optimum where fills are greater than 5 feet in depth. For fills less than five feet in depth, soils should be compacted to within a water content range of 2 percent below to 3 percent above optimum.

7.7 Cut and Fill Slopes

The stability of any cut or fill slopes at the project site will dependent upon the properties of the materials comprising the slope face and the susceptibility of slope soils to erosion. For permanent cut slopes in the typical poorly graded SAND and Silty SAND soil matrix encountered we recommend slopes no steeper than 3H:1V (horizontal:vertical) for maintenance reasons. Slopes should not exceed 2H:1V for stability reasons. It is assumed that appropriate slope erosion protection and/or planting will be utilized.

Where exposed slopes are predominantly made up of bare soil, slopes should be covered as quickly as possible with temporary or permanent protection in order to avoid unnecessary soil loss. If during construction rains are anticipated, flows over graded or disturbed areas should be minimized by diverting upslope surface water through the use of berms, ditches, or other diversion devices.

Soil slopes should be re-vegetated with native vegetation or provide other available ground covers such as netting, spray or hand-applied mulches, jute or excelsior vegetation, erosion matting, crushed rock other equivalent ground covers.

Erosional activity, if allowed to form and propagate, will increase soil loss and could result in loss of support to structures, streets and other facilities. Periodic maintenance and



prompt repair of erosional features is important to prevent soil loss. The effectiveness of erosion control measures should be evaluated after heavy or prolonged rains.

7.8 Ground Compaction and Shrinkage Factors

Ground surface lowering of one to two inches can occur by compaction of the surface soils to a 12-inch depth and to an average density of 95 percent of the ASTM D1557 maximum dry density. The approximate shrinkage of excavated on-site soils placed in compacted fills is estimated to be 15 percent.

The estimated shrinkages consider only material densification and do not consider other effects such as transport, wind, overcompaction, or compaction of subsoils to greater depths.

7.9 Compliance

Recommendations for foundations, slabs-on-grade, and pavements supported on compacted fills or prepared subgrade depend upon compliance with the **EARTHWORK** recommendations. To assess compliance, observation and testing should be performed under the direction of a WT geotechnical engineer. Please contact us to provide these observation and testing services.

8.0 LIMITATIONS

This report has been prepared assuming the project criteria described in Section 2.0. If changes in the project criteria occur, or if different subsurface conditions are encountered or become known, the conclusions and recommendations presented herein shall become invalid. In any such event, contact WT to assess the effect that such variations may have on our conclusions and recommendations. If WT is not retained for the construction observation and testing services to determine compliance with this report, our professional responsibility is accordingly limited.

The recommendations presented are based entirely upon data derived from a limited number of samples obtained from widely spaced borings. The attached logs are indicators of subsurface conditions only at the specific locations and times noted. This report assumes the uniformity of the geology and soil structure between borings, however variations can and often do exist. Whenever any deviation, difference or change is encountered or becomes known, WT should be contacted.




This report is for the exclusive benefit of our client alone. There are no intended third-party beneficiaries of our contract with the client or this report, and nothing contained in the contract or this report shall create any express or implied contractual or any other relationship with, or claim or cause of action for, any third party against WT.

This report is valid until the earlier of one year from the date of issuance, a change in circumstances, or discovered variations. After expiration, no person or entity shall have any right to rely on this report without the express written authorization of WT.

9.0 CLOSURE

We prepared this report as an aid to the designers of the proposed project. The comments, statements, recommendations and conclusions set forth in this report reflect the opinions of the authors. These opinions are based upon data obtained at the location of the borings, and from laboratory tests. Work on your project was performed in accordance with generally accepted standards and practices utilized by professionals providing similar services in this locality. No warranty, express or implied, is made.



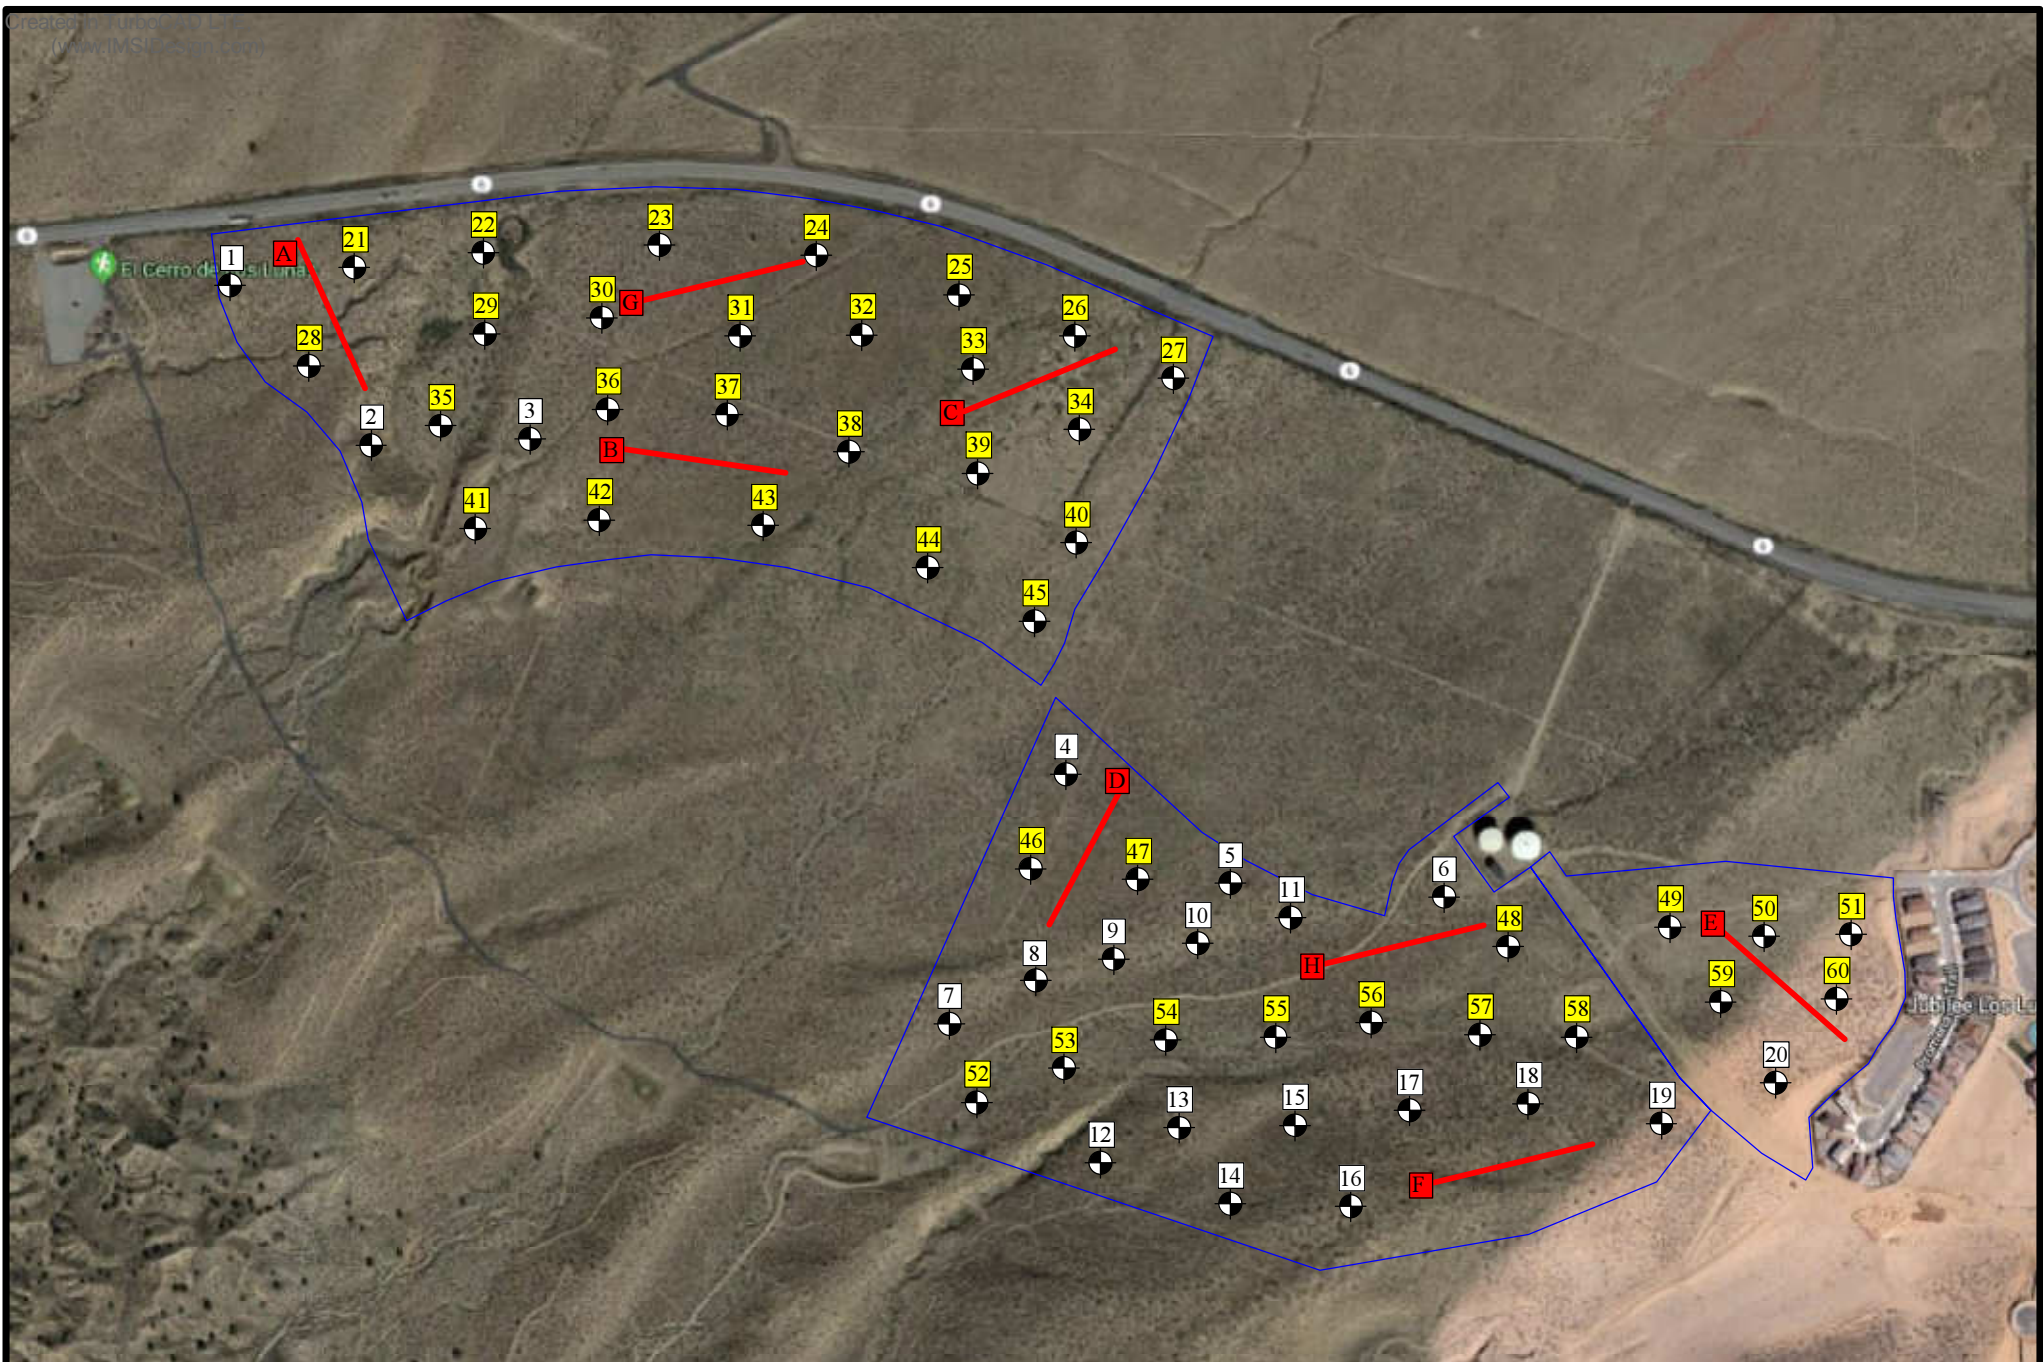

- Approximate Boring Location
- Proposed Tracts



Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

PROJECT: Sierra Vista Tracts A, E & F
JOB NO.: 3229JJ104

BORING LOCATION DIAGRAM

PLATE
1

Allowable Soil Bearing Capacity	The recommended maximum contact stress developed at the interface of the foundation element and the supporting material.
Backfill	A specified material placed and compacted in a confined area.
Base Course	A layer of specified aggregate material placed on a subgrade or subbase.
Base Course Grade	Top of base course.
Bench	A horizontal surface in a sloped deposit.
Caisson/Drilled Shaft	A concrete foundation element cast in a circular excavation which may have an enlarged base (or belled caisson).
Concrete Slabs-On-Grade	A concrete surface layer cast directly upon base course, subbase or subgrade.
Crushed Rock Base Course	A base course composed of crushed rock of a specified gradation.
Differential Settlement	Unequal settlement between or within foundation elements of a structure.
Engineered Fill	Specified soil or aggregate material placed and compacted to specified density and/or moisture conditions under observations of a representative of a soil engineer.
Existing Fill	Materials deposited through the action of man prior to exploration of the site.
Existing Grade	The ground surface at the time of field exploration.
Expansive Potential	The potential of a soil to expand (increase in volume) due to absorption of moisture.
Fill	Materials deposited by the actions of man.
Finished Grade	The final grade created as a part of the project.
Gravel Base Course	A base course composed of naturally occurring gravel with a specified gradation.
Heave	Upward movement.
Native Grade	The naturally occurring ground surface.
Native Soil	Naturally occurring on-site soil.
Rock	A natural aggregate of mineral grains connected by strong and permanent cohesive forces. Usually requires drilling, wedging, blasting or other methods of extraordinary force for excavation.
Sand and Gravel Base Course	A base course of sand and gravel of a specified gradation.
Sand Base Course	A base course composed primarily of sand of a specified gradation.
Scarify	To mechanically loosen soil or break down existing soil structure.
Settlement	Downward movement.
Soil	Any unconsolidated material composed of discrete solid particles, derived from the physical and/or chemical disintegration of vegetable or mineral matter, which can be separated by gentle mechanical means such as agitation in water.
Strip	To remove from present location.
Subbase	A layer of specified material placed to form a layer between the subgrade and base course.
Subbase Grade	Top of subbase.
Subgrade	Prepared native soil surface.



COARSE-GRAINED SOILS
LESS THAN 50% FINES

GROUP SYMBOLS	DESCRIPTION	MAJOR DIVISIONS
GW	WELL-GRADED GRAVEL OR WELL-GRADED GRAVEL WITH SAND, LESS THAN 5% FINES	GRAVELS MORE THAN HALF OF COARSE FRACTION IS LARGER THAN NO. 4 SIEVE SIZE
GP	POORLY-GRADED GRAVEL OR POORLY-GRADED GRAVEL WITH SAND, LESS THAN 5% FINES	
GM	SILTY GRAVEL OR SILTY GRAVEL WITH SAND, MORE THAN 12% FINES	
GC	CLAYEY GRAVEL OR CLAYEY GRAVEL WITH SAND, MORE THAN 12% FINES	
SW	WELL-GRADED SAND OR WELL-GRADED SAND WITH GRAVEL, LESS THAN 5% FINES	SANDS MORE THAN HALF OF COARSE FRACTION IS SMALLER THAN NO. 4 SIEVE SIZE
SP	POORLY-GRADED SAND OR POORLY-GRADED SAND WITH GRAVEL, LESS THAN 5% FINES	
SM	SILTY SAND OR SILTY SAND WITH GRAVEL, MORE THAN 12% FINES	
SC	CLAYEY SAND OR CLAYEY SAND WITH GRAVEL, MORE THAN 12% FINES	

NOTE: Coarse-grained soils receive dual symbols if they contain 5% to 12% fines (e.g., SW-SM, GP-GC).

FINE-GRAINED SOILS
MORE THAN 50% FINES

GROUP SYMBOLS	DESCRIPTION	MAJOR DIVISIONS
ML	SILT, SILT WITH SAND OR GRAVEL, SANDY SILT, OR GRAVELLY SILT	SILTS AND CLAYS LIQUID LIMIT LESS THAN 50
CL	LEAN CLAY OF LOW TO MEDIUM PLASTICITY, SANDY CLAY, OR GRAVELLY CLAY	
OL	ORGANIC SILT OR ORGANIC CLAY OF LOW TO MEDIUM PLASTICITY	
MH	ELASTIC SILT, SANDY ELASTIC SILT, OR GRAVELLY ELASTIC SILT	SILTS AND CLAYS LIQUID LIMIT MORE THAN 50
CH	FAT CLAY OF HIGH PLASTICITY, SANDY FAT CLAY, OR GRAVELLY FAT CLAY	
OH	ORGANIC SILT OR ORGANIC CLAY OF HIGH PLASTICITY	
PT	PEAT AND OTHER HIGHLY ORGANIC SOILS	HIGHLY ORGANIC SOILS

NOTE: Fine-grained soils may receive dual classification based upon plasticity characteristics (e.g. CL-ML).

SOIL SIZES

COMPONENT	SIZE RANGE
BOULDERS	Above 12 in.
COBBLES	3 in. – 12 in.
GRAVEL	No. 4 – 3 in.
Coarse	¾ in. – 3 in.
Fine	No. 4 – ¾ in.
SAND	No. 200 – No. 4
Coarse	No. 10 – No. 4
Medium	No. 40 – No. 10
Fine	No. 200 – No. 40
Fines (Silt or Clay)	Below No. 200

NOTE: Only sizes smaller than three inches are used to classify soils

CONSISTENCY

CLAYS & SILTS	BLOWS PER FOOT
VERY SOFT	0 – 2
SOFT	3 – 4
FIRM	5 – 8
STIFF	9 – 15
VERY STIFF	16 – 30
HARD	OVER 30

RELATIVE DENSITY

SANDS & GRAVELS	BLOWS PER FOOT
VERY LOOSE	0 – 4
LOOSE	5 – 10
MEDIUM DENSE	11 – 30
DENSE	31 – 50
VERY DENSE	OVER 50

NOTE: Number of blows using 140-pound hammer falling 30 inches to drive a 2-inch-OD (1½-inch ID) split-barrel sampler (ASTM D1586).

PLASTICITY OF FINE GRAINED SOILS

PLASTICITY INDEX	TERM
0	NON-PLASTIC
1 – 7	LOW
8 – 20	MEDIUM
Over 20	HIGH

DEFINITION OF WATER CONTENT

DRY
SLIGHTLY DAMP
DAMP
MOIST
WET
SATURATED



The number shown in "**BORING NO.**" refers to the approximate location of the same number indicated on the "Boring Location Diagram" as positioned in the field by pacing or measurement from property lines and/or existing features, or through the use of Global Positioning System (GPS) devices. The accuracy of GPS devices is somewhat variable.

"**DRILLING TYPE**" refers to the exploratory equipment used in the boring wherein **HSA = hollow stem auger**, and the dimension presented is the outside diameter of the HSA used.

"**N**" in "**BLOW COUNTS**" refers to a 2-inch outside diameter split-barrel sampler driven into the ground with a 140 pound drop-hammer dropped 30 inches repeatedly until a penetration of 18 inches is achieved or until refusal. The number of blows, or "blow count", of the hammer is recorded for each of three 6-inch increments totaling 18 inches. The number of blows required for advancing the sampler for the last 12 inches (2nd and 3rd increments) is defined as the Standard Penetration Test (SPT) "**N**"-Value. Refusal to penetration is considered more than 50 blows per 6 inches. (Ref. ASTM D1586).

"**R**" in "**BLOW COUNTS**" refers to a 3-inch outside diameter ring-lined split barrel sampler driven into the ground with a 140 pound drop-hammer dropped 30 inches repeatedly until a penetration of 12 inch is achieved or until refusal. The number of blows required to advance the sampler 12 inches is defined as the "**R**" blow count. The "**R**" blow count requires an engineered conversion to an equivalent SPT N-Value. Refusal to penetration is considered more than 50 blows per foot. (Ref. ASTM D3550).

"**CS**" in "**BLOWS/FT.**" refers to a 2½-in. outside diameter California style split-barrel sampler, lined with brass sleeves, driven into the ground with a 140-pound hammer dropped 30 inches repeatedly until a penetration of 18 inches is achieved or until refusal. The number of blows of the hammer is recorded for each of the three 6-inch increments totaling 18 inches. The number of blows required for advancing the sampler for the last 12 inches (2nd and 3rd increments) is defined as the "**CS**" blow count. The "**CS**" blow count requires an engineered conversion to an equivalent SPT N-Value. Refusal to penetration is considered more than 50 blows for a 6-inch increment. (Ref. ASTM D 3550)

"**SAMPLE TYPE**" refers to the form of sample recovery, in which **N** = Split-barrel sample, **R** = Ring-lined sample, "**CS**" = California style split-barrel sample, **G** = Grab sample, **B** = Bucket sample, **C** = Core sample (ex. diamond bit rock coring).

"**DRY DENSITY (LBS/CU FT)**" refers to the laboratory-determined dry density in pounds per cubic foot. The symbol "**NR**" indicates that no sample was recovered.

"**WATER (MOISTURE) CONTENT**" (% of Dry Wt.) refers to the laboratory-determined water content in percent using the standard test method ASTM D2216.

"**USCS**" refers to the "Unified Soil Classification System" Group Symbol for the soil type as defined by ASTM D2487 and D2488. The soils were classified visually in the field, and where appropriate, classifications were modified by visual examination of samples in the laboratory and/or by appropriate tests.

These notes and boring logs are intended for use in conjunction with the purposes of our services defined in the text. Boring log data should not be construed as part of the construction plans nor as defining construction conditions.

Boring logs depict our interpretations of subsurface conditions at the locations and on the date(s) noted. Variations in subsurface conditions and characteristics may occur between borings. Groundwater levels may fluctuate due to seasonal variations and other factors.

The stratification lines shown on the boring logs represent our interpretation of the approximate boundary between soil or rock types based upon visual field classification at the boring location. The transition between materials is approximate and may be more or less gradual than indicated.

<p><i>Geotechnical Environmental Inspections Materials</i></p>  <p>Western Technologies Inc. The Quality People Since 1955 wt-us.com</p>	<p>BORING LOG NOTES</p>	<p>PLATE A-3</p>
--	--------------------------------	-----------------------------

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 1

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
3.0		G				SM		Silty SAND; light brown, medium dense, damp
3.4	111	R		45				white light brown
2.6	110	R		24	5			brown
5.5	114	R		46	10	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp, some gravel
		N		36	15	SM		Silty SAND; light brown, dense, damp
		N		58	20	SP-SM		Poorly Graded SAND with Silt; white light brown, very dense, damp
		N		54	25			
		N		56	30			tan brown
		N		77	35			
		N		93/10"	40	SM		Silty SAND; light brown, very dense, damp
BORING TERMINATED AT 41.5 FEET								
45								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials

Western Technologies Inc.
 The Quality People Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-4

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 2

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
4.8		G				SC-SM		Silty, Clayey SAND; light brown, medium dense, damp
		N		16				
		N		13	5	SM		Silty SAND; light brown, medium dense, damp
		N		11	10			
		N		14	15			
		N		11	20			
		G						
		N		11	25			
		N		6	30			loose
		N		20	35			medium dense
		N		25	40			
BORING TERMINATED AT 41.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-5

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 3

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.2		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.8	109	R		25				
1.3	120	R		33	5	SM		Silty SAND; light brown, medium dense, damp
5.6		G						
1.7	122	R		31	10			Poorly Graded SAND with Silt; brown, medium dense, damp
2.2		N		19	15	SP-SM		
		G						
		N		24	20			
		N		24	25			
		N		19	30			
		N		21	35			
		N		27	40			
BORING TERMINATED AT 41.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-6

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 4

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
17.6	89	G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp, some gravel
		R		16				
1.2	110	R		21	5	SP		Poorly Graded SAND; light brown, medium dense, damp, with gravel
		R		19	10			
1.2	111	R		19	10			
		N		22	15	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		19	20			
		N		48	25			
		N		29	30			with gravel
		N		17	35			
		N		28	40			
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-7

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 5

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		10		SM		Silty SAND; light brown, loose, damp
2.1		G		12	5	SP		Poorly Graded SAND; light brown, medium dense, damp
		N		17	10			
2.0		G		31	15			
		N		14	20			
		N		17	25			
		N		18	30	SC-SM		Silty, Clayey SAND; brown, medium dense, damp
		N		13	35			BORING TERMINATED AT 41.5 FEET
		N		16	40			
					45			

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials

Western Technologies Inc.
 The Quality People Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104
BORING LOG

PLATE
A-8

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 6

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7" HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.1		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		13				
		N		12	5			
1.8		N		23	10			gravel
		G						
		N		16	15	SM		Silty SAND; brown to light brown, medium dense, damp
		N		18	20			
		N		32	25			
		N		23	30			
		N		30	35			brown
		N		25	40			
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-9

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 7

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.2		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		13				
		N		12	5	SM		Silty SAND; light brown, medium dense, damp
		N		14	10			
		N		18	15			
		N		33	20	SP-SM		Poorly Graded SAND with Silt; light brown, dense, damp, some gravel
		N		36	25			no gravel
		N		36	30			
		N		39	35			
		N		56	40			very dense
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-10

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 8

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.6	102	R		17		SM		Silty SAND; light brown, medium dense, damp
1.1	107	R		56	5			dense
2.9	102	R		28	10			medium dense
		N		22	15			
		N		30	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		54	25			very dense
		N		23	30	SM		Silty SAND; light brown, medium dense, damp
		N		33	35			dense
		N		30	40			medium dense
BORING TERMINATED AT 41.5 FEET								
45								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-11

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 9

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.3		G				SP		Poorly Graded SAND; light brown, medium dense, damp
		N		16				
		N		27	5			
		N		50	10			some gravel
1.1		N		50	15			
		G						
		N		28	20			medium dense
		N		22	25			
		N		30	30	SC-SM		Silty, Clayey SAND; brown, medium dense, damp
		N		31	35	SM		Silty SAND; light brown, dense, damp
		N		37	40			
BORING TERMINATED AT 41.5 FEET								
45								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-12

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 10

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
3.7	99	R		20		SM		Silty SAND; light brown, medium dense, damp
0.9	111	R		39	5	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.3	109	R		39	10			
		N		35	15			dense
		N		51	20			very dense
		N		18	25	SM		Silty SAND; light brown, medium dense, damp
		N		31	30			dense
		N		31	35			
		N		21	40			medium dense
BORING TERMINATED AT 41.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-13

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 11

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, medium dense, damp, some gravel
2.7	101	R		17				
2.1	100	R		14	5	SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp medium dense dense, with gravel very dense
1.6	105	R		19	10			
1.5	122	R		44	15			
		N		69	20			
		N		23	25	SC-SM		Silty, Clayey SAND; brown, medium dense, damp
		N		13	30	SM		
		N		15	35			Silty SAND; light brown, medium dense, damp
		N		20	40			
BORING TERMINATED AT 41.5 FEET								
45								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-14

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 12

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
3.3		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
2.2	105	R		17				
2.7	101	R		13	5	SM		Silty SAND; light brown, loose, damp
2.4	102	R		21	10			medium dense
		N		16	15			
		N		15	20			
		N		6	25	SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
		N		11	30			medium dense
		N		29	35			
		N		23	40	SM		Silty SAND; light brown, medium dense, damp
					41.5			BORING TERMINATED AT 41.5 FEET

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-15

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 13

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		16		SM		Silty SAND; light brown, medium dense, damp
		N		13	5			
		N		15	10			
		N		20	15			
		N		19	20			
		N		16	25			
		N		13	30	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		22	35			
		N		27	40			
BORING TERMINATED AT 41.5 FEET								
					45			

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials

Western Technologies Inc.
 The Quality People Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104
BORING LOG

PLATE
A-16

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 14

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		G				SM		Silty SAND; light brown, medium dense, damp
		N		11				
		N		11	5			
		N		11	10			
		N		27	15			
		N		18	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		20	25			
		N		19	30			
		N		23	35			
		N		37	40			dense
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-17

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 15

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		22		SM		Silty SAND; light brown, medium dense, damp
		N		15	5			
		N		14	10			
		N G		16	15			
		N		15	20			
		N		21	25			
		N		25	30			
		N		24	35			
		N		25	40	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
					45			BORING TERMINATED AT 41.5 FEET

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-18

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 16

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, medium dense, damp
	99	R		27				
	98	R		19	5	SM		Silty SAND; light brown, medium dense, damp
	102	R		18	10			
		N		12	15			
		N		15	20			
		N		16	25			
		N		28	30	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		23	35			
		N		25	40			
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-19

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 17

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7" HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		20		SM		Silty SAND; light brown, medium dense, damp
		N		15	5			
		N		16	10			
		N		17	15			
		N		27	20			
		N		30	25	SP-SM		Poorly Graded SAND with Silt; tan brown, medium dense, damp
		N		25	30			
		N		23	35			
		N		28	40			BORING TERMINATED AT 41.5 FEET
					45			

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-20

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 18

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		8		SM		Silty SAND; light brown, loose, moist damp
		N		9	5			
		N		15	10			
		N		15	15			
		N G	 	23	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		24	25			
		N		32	30			
		N		17	35			
		N		23	40			medium dense
BORING TERMINATED AT 41.5 FEET								
					45			

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-21

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 19

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.5	99	G				SM		Silty SAND; light brown, medium dense, damp
		R		28				
1.4	99	R		19	5			
		R		20				
1.6	102	R		20	10			
		N		18	15	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		33	20			dense
		N		32	25	SM		Silty SAND; light brown, dense, damp
		N		22	30			medium dense
		N		31	35			dense
		N		34	40			
BORING TERMINATED AT 41.5 FEET								
45								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-22

DATE DRILLED: 11-12-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 20

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, loose, damp
		N		10				
		N		12	5	SM		Silty SAND; light brown, medium dense, damp
		N		15	10			
		N		20	15			
		N		28	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		29	25			
		N		18	30			
		N		24	35			
		N		22	40			
								BORING TERMINATED AT 41.5 FEET
					45			

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-23

DATE DRILLED: 11-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 21

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		G				SM		Silty SAND; light brown, loose, damp
		N		10				some gravel
		N		12	5	SP-SM		Poory Graded SAND with Silt; light brown, loose, damp medium dense
		N		20	10			
		N		57	15			dense, with gravel
		N		28	20	CL		Sandy Lean CLAY; white light brown, very stiff, damp to moist
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-24

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 22

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
4.6		G				SM		Silty SAND; light brown, medium dense, damp
2.1	105	R		27				
2.5	110	R		19	5	SP-SM		Poorly Graded SAND with Silt; brown, medium dense, damp
3.0	103	R		14	10	SM		Silty SAND; light brown, medium dense, damp to moist loose
		N		9	15			
		N		17	20			medium dense
BORING TERMINATED AT 21.5 FEET								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG






PLATE
A-25

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 23

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
						SM		Silty SAND; light brown, medium dense, damp
		N		21		SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		29	5			with gravel
		N		19	10			
		N		23	15	SM		Silty SAND; light brown, medium dense, damp
		N		25	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG









PLATE
A-26

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 24

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		21		SM		Silty SAND; light brown, medium dense, damp
		N		40	5	SP-SM		Poorly Graded SAND with Silt; light brown, dense, damp, some gravel
		N		20	10			medium dense, no gravel
		N		12	15	SM		Silty SAND; light brown, medium dense, damp
		N		20	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-27

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 25

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		20		SM		Silty SAND; light brown, medium dense, damp
		N		12	5			
		N		13	10			
		N		14	15			
		N		17	20			
								BORING TERMINATED AT 21.5 FEET

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-28

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 26

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.9		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
15.8	92	R		13				
0.6	122	R		33	5	SM		Silty SAND; light brown, medium dense, some gravel
2.2	103	R		18	10			
		N		16	15			
		N		17	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-29

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 27

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.5		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.8	108	R		25				
2.1	103	R		18	5	SM		Silty SAND; light brown, medium dense, damp
1.0	115	R		40	10	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		23	15	SM		Silty SAND; light brown, medium dense, damp
		N		26	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-30

DATE DRILLED: 11-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 28

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7" HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.0		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
2.0	109	R		15				
		N		14	5	SM		Silty SAND; light brown, medium dense, damp
		N		10	10			loose
		N		12	15			medium dense
		N		14	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-31

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 29

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.0		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		11				
		N		30	5	SM		Silty SAND; light brown, medium dense, damp
		N		17	10			
		N		20	15			
		N		20	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-32

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 30

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.6		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.0	107	R		16				
1.0	121	R		38	5			with gravel
1.4	111	R		24	10			
		N		24	15	SM		Silty SAND; light brown, medium dense, damp
		N		29	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-33

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 31

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.6		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		18				
		N		28	5			
		N		30	10			
		N		37	15			dense
		N		28	20			medium dense
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-34

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 32

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.5		G				SP-SM		Poory Graded SAND with Silt; tan brown, medium dense, damp
1.3	120	R		32				
1.3	111	R		19	5			
		N		36	10			with gravel
		N		20	15	SM		Silty SAND; light brown, medium dense, damp
		N		16	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG









PLATE
A-35

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 33

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		17		SM		Silty SAND; light brown, medium dense, damp
		N		15	5			
		N		18	10			
		N		23	15	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		17	20	SM		Silty SAND; light brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG








PLATE
A-36

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 34

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		14		SM		Silty SAND; light brown, medium dense, damp
		N		13	5			
		N		34	10	SP-SM		Poorly Graded SAND with Silt; light brown, dense, damp
		N		24	15			medium dense
		N		40	20			dense
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-37

DATE DRILLED: 11-13-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 35

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
						SM		Silty SAND; light brown, loose, damp
		N		9				
		N		10	5			
		N		14	10			medium dense
		N		15	15			
		N		17	20			
								BORING TERMINATED AT 21.5 FEET

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG











PLATE
A-38

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 36

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		17		SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		27	5			some gravel
		N		18	10	SM		Silty SAND; light brown, medium dense, damp
		N		11	15			
		N		30	20	SP-SM		Poorly Graded SAND with Silt; tan brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG









PLATE
A-39

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 37

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.1	111	R		27		SM		Silty SAND; light brown, medium dense, damp
0.7	123	R		28	5	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp, with gravel
		N		18	10			
		N		16	15	SM		Silty SAND; light brown, medium dense, damp
		N		24	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-40

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 38

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.1		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		14				
		N		15	5	SM		Silty SAND; light brown, medium dense, damp
		N		20	10			
		N		19	15	SP-SM		Poorly Graded SAND with Silt; tan brown, medium dense, damp, some gravel
		N		13	20	SM		Silty SAND; light brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-41

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 39

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.1		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
2.5	103	R		15				
1.6	106	R		19	5	SM		Silty SAND; light brown, medium dense, damp
1.1	109	R		24	10			
		N		15	15			
		N		14	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-42

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 40

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.7		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		16				
		N		10	5	SM		Silty SAND; light brown, loose, damp
		N		21	10			medium dense
		N		12	15			
		N		21	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-43

DATE DRILLED: 10-16-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 41

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.4		G				SM		Silty SAND; light brown, medium dense, damp
1.7	101	R		18				
1.4	107	R		26	5			
1.7	108	R		28	10			
		N		19	15			
		N		17	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**


Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-44

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 42

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.2		G				SP		Poorly Graded SAND; light brown, very loose, damp
		N		2				
		N		5	5	SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
		N		48	10			dense
		N		22	15	SM		Silty SAND; light brown, medium dense, damp
		N		27	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG









PLATE
A-45

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 43

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.2	108	R		24		SM		Silty SAND; light brown, medium dense, damp
1.4	107	R		23	5	SP-SM		Poorly Graded SAND with Silt; tan brown, medium dense, damp
		R		33	10			with gravel
		N		15	15	SM		Silty SAND; light brown, medium dense, damp
		N		22	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG








PLATE
A-46

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 44

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		13		SM		Silty SAND; light brown, medium dense, damp
		N		14	5			
		N		15	10			
		N		18	15			
		N		20	20	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical
 Environmental
 Inspections
 Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-47

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 45

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.6		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.5	106	R		31				
5.3	102	R		26	5	SM		Silty SAND; light brown, medium dense, damp
1.4	107	R		25	10			
		N		21	15	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		27	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-48

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 46

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.0		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
		N		9				
		N		11	5	SM		Silty SAND; light brown, medium dense, damp
		N		9	10			loose
		N		21	15			
		N		14	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-49

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 47

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.2		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, moist
1.7	104	R		12				
2.0	107	R		14	5			
						SM		Silty SAND; light brown, loose, moist
1.8	106	R		19	10			medium dense
		N		19	15			some gravel
		N		16	20			
BORING TERMINATED AT 21.5 FEET								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-50

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 48

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.3		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
		N		9				
		N		9	5	SM		Silty SAND; light brown, loose, damp
		N		31	10	SP-SM		Poorly Graded SAND with Silt; light brown, dense, damp, with gravel
		N		28	15			medium dense
		N		18	20	SM		Silty SAND; light brown, meidum dense, damp
BORING TERMINATED AT 21.5 FEET								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials

Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG







PLATE
A-51

DATE DRILLED: 10-29-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 49

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.6	104	R		24		SM		Silty SAND; light brown, medium dense, damp
2.6	102	R		17	5			
2.5	100	R		23	10			
		N		13	15			
		N		18	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-52

DATE DRILLED: 10-29-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 50

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.3		G				SP-SM		Poorly Graded SAND with Silt; light brown, loose, damp
		N		8				
		N		8	5	SM		Silty SAND; light brown, loose, damp
		N		15	10	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		19	15			
		N		21	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-53

DATE DRILLED: 10-29-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 51

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
2.0		G				SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		12				
		N		9	5	SM		Silty SAND; light brown, loose, damp
		N		10	10			
		N		14	15			medium dense
		N		12	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-54

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 52

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: B. Crawford

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, medium dense, damp
		N		25				
		N		22	5	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		25	10			
		N		27	15			
		N		13	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-55

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 53

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: B. Crawford

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, very dense, damp
1.0	118	R		50/7"				
1.2	116	R		20	5	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
1.0	113	R		22	10			
		N		34	15	SP		Poorly Graded SAND; light brown, dense damp
		N		22	20	SM		Silty SAND; light brown, medium dense, damp
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-56

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 54

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: B. Crawford

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.8		G				SP		Poorly Graded SAND; light brown, medium dense, damp
		N		12				
		N		11	5	SM		Silty SAND; light brown, medium dense, damp
		N		19	10	SP-SM		Poorly Graded SAND with Silt; light brown, medium dense, damp
		N		23	15	SM		Silty SAND; light brown, medium dense, damp
		N		43	20			dense
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG







PLATE
A-57

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 55

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.0	106	R		10		SM		Silty SAND; light brown, loose, damp, with gravel
1.7	118	R		17	5			
1.6	105	R		17	10			
		N		13	15			red brown, less gravel
		N		18	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG







PLATE
A-58

DATE DRILLED: 10-15-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 56

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION	
		N		9		SM		Silty SAND; light brown, loose, damp	
		N		10	5				
		N		15	10				medium dense
		N		14	15				
		N		26	20				
BORING TERMINATED AT 21.5 FEET									

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-59

DATE DRILLED: 10-29-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 57

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.6		G				SP		Poorly Graded SAND; light brown, medium dense, damp, with gravel
		N		23				
		N		15	5			
		N		33	10			dense
		N		17	15	SM		Silty SAND; brown, medium dense, damp
		N		31	20			dense
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-60

DATE DRILLED: 10-14-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 58

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
4.1		G				SP-SM		Poorly Graded SAND with Silt; tan brown, loose, moist
3.4	100	R		11				
3.4	99	R		13	5			
2.6	100	R		11	10	SM		Silty SAND; tan brown, loose, moist
		N		16	15			medium dense, damp
		N		14	20			
BORING TERMINATED AT 21.5 FEET								

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG







PLATE
A-61

DATE DRILLED: 10-29-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 59

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: K. Newberry

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
1.1	103	R		17		SM		Silty SAND; light brown, medium dense, damp
0.9	108	R		23	5			
1.8	106	R		19	10			
		N		15	15			
		N		14	20			
BORING TERMINATED AT 21.5 FEET								

N- STANDARD PENETRATION TEST
 R- RING SAMPLE
 NR- NO SAMPLE RECOVERY
 G- GRAB SAMPLE
 B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**

Geotechnical Environmental Inspections Materials

Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG







PLATE
A-62

DATE DRILLED: 11-12-19
 LOCATION: See Location Diagram
 ELEVATION: Not Determined

BORING NO. 60

EQUIPMENT TYPE: CME-75
 DRILLING TYPE: 7"HSA
 FIELD ENGINEER: J. Phillips

THIS SUMMARY APPLIES ONLY AT THIS LOCATION AND AT THE TIME OF LOGGING. CONDITIONS MAY DIFFER AT OTHER LOCATIONS AND MAY CHANGE AT THIS LOCATION WITH TIME. DATA PRESENTED IS A SIMPLIFICATION.

MOISTURE CONTENT (% OF DRY WT.)	DRY DENSITY (LBS/CU FT)	SAMPLE TYPE	SAMPLE	BLOW COUNTS	DEPTH (FEET)	USCS	GRAPHIC	SOIL DESCRIPTION
		N		11		SM		Silty SAND; light brown, medium dense, damp
		N		14	5			
		N		16	10			
		N		16	15			
		N		15	20			
								BORING TERMINATED AT 21.5 FEET

- N- STANDARD PENETRATION TEST
- R- RING SAMPLE
- NR- NO SAMPLE RECOVERY
- G- GRAB SAMPLE
- B- BUCKET SAMPLE

NOTES: **Groundwater Not Encountered**



Western Technologies Inc.
 The Quality People
 Since 1955

PROJECT: SIERRA VISTA TRACTS A, E & F
 JOB NO.: 3229JJ104

BORING LOG

PLATE
A-63

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index			
						In-Situ	After Saturation							
1	0-5	SM		3.0					--	NP	12			
1	5-6	SM	107	2.6	0.6	0.8	119.8	8.4	--	NP	10			
					1.1	1.6								
					2.2	2.1								2.9
					4.4									4.5
2	0-5	SC-SM		4.8					22	4	34			
3	0-5	SP-SM		2.2					--	NP	10			
3	5-10	SM		5.6					--	NP	30			
3	15-20	SP-SM		2.2					--	NP	10			
4	2-3	SP-SM	86	17.6	0.5	0.2	119.8	8.4	--	NP	10			
					1.0	0.4								
					2.0	0.5								2.4
					4.0									2.9
5	5-10	SP		2.1					--	NP	4			
5	15-20	SP		2.0					--	NP	4			
6	0-5	SP-SM		2.1					--	NP	10			

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.

*Geotechnical
Environmental
Inspections
Materials*

Western Technologies Inc.
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
 JOB NO.: **3229JJ104**

PLATE
B-1

SOIL PROPERTIES

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index			
						In-Situ	After Saturation							
6	10-15	SP-SM		1.8					--	NP	10			
7	0-5	SP-SM		2.2				120.1	9.7	--	NP	9		
8	2-3	SM	96	2.6	0.5	0.9								
					1.0	1.1								
					2.0	1.6	6.8							2
					4.0		7.6							2
9	0-5	SP		1.3					--	NP	5			
9	15-20	SP		1.1					--	NP	2			
10	2-3	SM	99	3.7	0.5	0.8								
					1.0	1.2								
					2.0	1.4	3.7							2
					4.0		4.4							2
11	0-5	SP		1.8					--	NP	4			
11	5-6	SP-SM	100	2.1	0.5	0.3								
					1.0	0.8								
					2.0	0.9	4.0							2
					4.0		4.9							2
12	0-5	SP-SM		3.3					--	NP	7			

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.

*Geotechnical
Environmental
Inspections
Materials*

**Western
Technologies Inc.**
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
 JOB NO.: **3229JJ104**

SOIL PROPERTIES

PLATE
B-2

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index			
						In-Situ	After Saturation							
16	0-5	SP		1.8					--	NP	3			
20	0-5	SP		1.8					--	NP	3			
22	0-5	SM		4.6					--	NP	20			
22	5-6	SP-SM	112	2.5	0.6	0.1								
					1.1	0.3								
					2.2	0.5	4.3							
					4.4		5.2							
22	10-11	SM	102	3.0	0.6	1.6								
					1.1	2.1								
					2.2	2.3	4.1							
					4.4		4.9							
26	0-5	SP-SM		1.9					--	NP	7			
26	2-3	SP-SM	91	15.8	0.5	0.2								
					1.0	0.4								
					2.0	0.6	2.0							
					4.0		2.4							
27	0-5	SP-SM		2.5					--	NP	11			

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.

*Geotechnical
Environmental
Inspections
Materials*

**Western
Technologies Inc.**
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
JOB NO.: **3229JJ104**

SOIL PROPERTIES

PLATE
B-3

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index			
						In-Situ	After Saturation							
28	0-5	SP-SM		2.0				116.4	8.6	--	NP	8		
29	0-5	SP-SM		2.0						--	NP	10		
30	0-5	SP-SM		1.6						--	NP	9		
31	0-5	SP-SM		1.6						--	NP	9		
32	0-5	SP-SM		1.5						--	NP	6		
38	0-5	SP-SM		1.1						--	NP	7		
39	0-5	SP-SM		2.1						--	NP	9		
39	2-3	SP-SM	101	2.5	0.5	0.4								
					1.0	0.6								
					2.0	1.0	4.1							2
					4.0		4.7							2
40	0-5	SP-SM		2.7						--	NP	8		
41	0-5	SM		2.4						--	NP	16		
42	0-5	SP		1.2						--	NP	5		
45	0-5	SP-SM		1.6						--	NP	11		
46	0-5	SP-SM		2.0						--	NP	8		
47	0-5	SP-SM		1.2						--	NP	5		

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.

*Geotechnical
Environmental
Inspections
Materials*

**Western
Technologies Inc.**
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
JOB NO.: **3229JJ104**

PLATE
B-4

SOIL PROPERTIES

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks	
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index				
						In-Situ	After Saturation								
47	2-3	SP-SM	99	1.7	0.5	0.3									
					1.0	0.4									
					2.0	0.8									3.0
					4.0										3.7
47	5-6	SP-SM	105	2.0	0.5	0.3									
					1.0	0.5									
					2.0	0.9									4.0
					4.0										5.0
48	0-5	SP-SM		2.3					--	NP	8				
50	0-5	SP-SM		2.3					--	NP	8				
51	0-5	SP-SM		2.0					--	NP	6				
52	0-5	SP		1.8			122.9	6.4	--	NP	4				
53	0-5	SP		1.8					--	NP	5				
54	0-5	SP	0	1.8			119.5	5.2	--	NP	4				

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.

*Geotechnical
Environmental
Inspections
Materials*

**Western
Technologies Inc.**
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
 JOB NO.: **3229JJ104**

SOIL PROPERTIES

PLATE
B-5

Boring No.	Depth (ft.)	USCS Class.	Initial Dry Density (pcf)	Initial Water Content (%)	Compression Properties			Proctor Values		Plasticity		Percent Passing #200	Soluble Sulfate (ppm)	Remarks	
					Surcharge (ksf)	Total Compression (%)		Maximum Dry Density (pcf)	Optimum Moisture (%)	Liquid Limit	Plasticity Index				
						In-Situ	After Saturation								
55	2-3	SM	104	1.0	0.6	0.1									
					1.1	0.3									
					2.2	0.6									3.1
					4.4										3.7
57	0-5	SP		1.6			116.9	8.4	--	NP	3				
58	0-5	SP-SM		4.1					--	NP	10				
59	2-3	SM	103	1.1	0.6	0.3									
					1.1	0.6									
					2.2	1.0									2.4
					4.4										3.0

Note: Initial Dry Density and Initial Water Content are in-situ values unless otherwise noted.
NP = Non-Plastic

Remarks

1. Compacted density (approx. 95% of ASTM D1557 max. density at moisture content slightly below optimum.)
2. Submerged to approximate saturation.
3. Slight rebound after saturation.
4. Sample disturbance observed.


*Geotechnical
Environmental
Inspections
Materials*

Western Technologies Inc.
 The Quality People
 Since 1955
 wt-us.com

PROJECT: **Sierra Vista Tracts A, E & F**
 JOB NO.: **3229JJ104**

SOIL PROPERTIES

PLATE
B-6

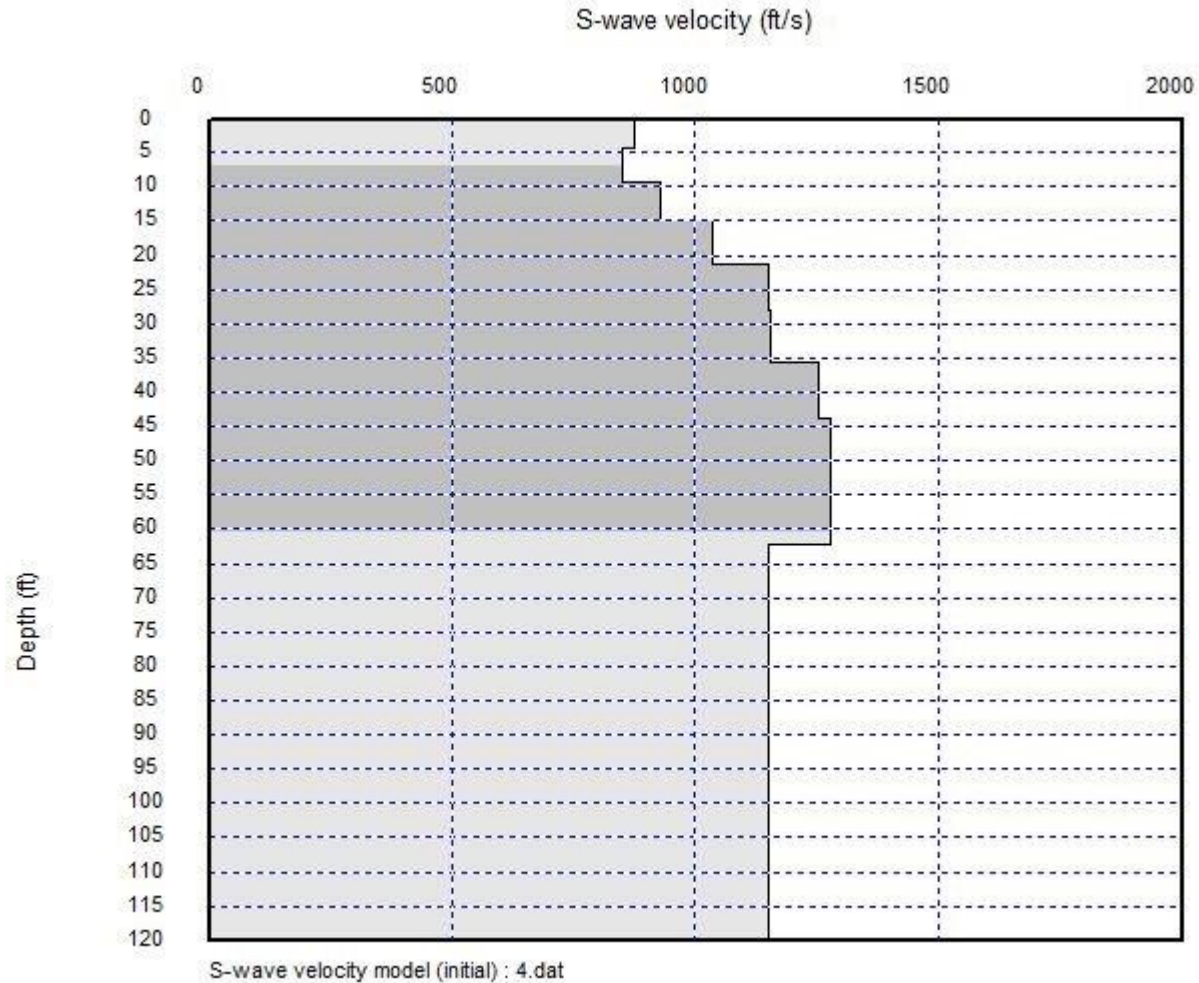

Line A

AVS = 1120.15 ft/s

Site Classification is Class D

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-1

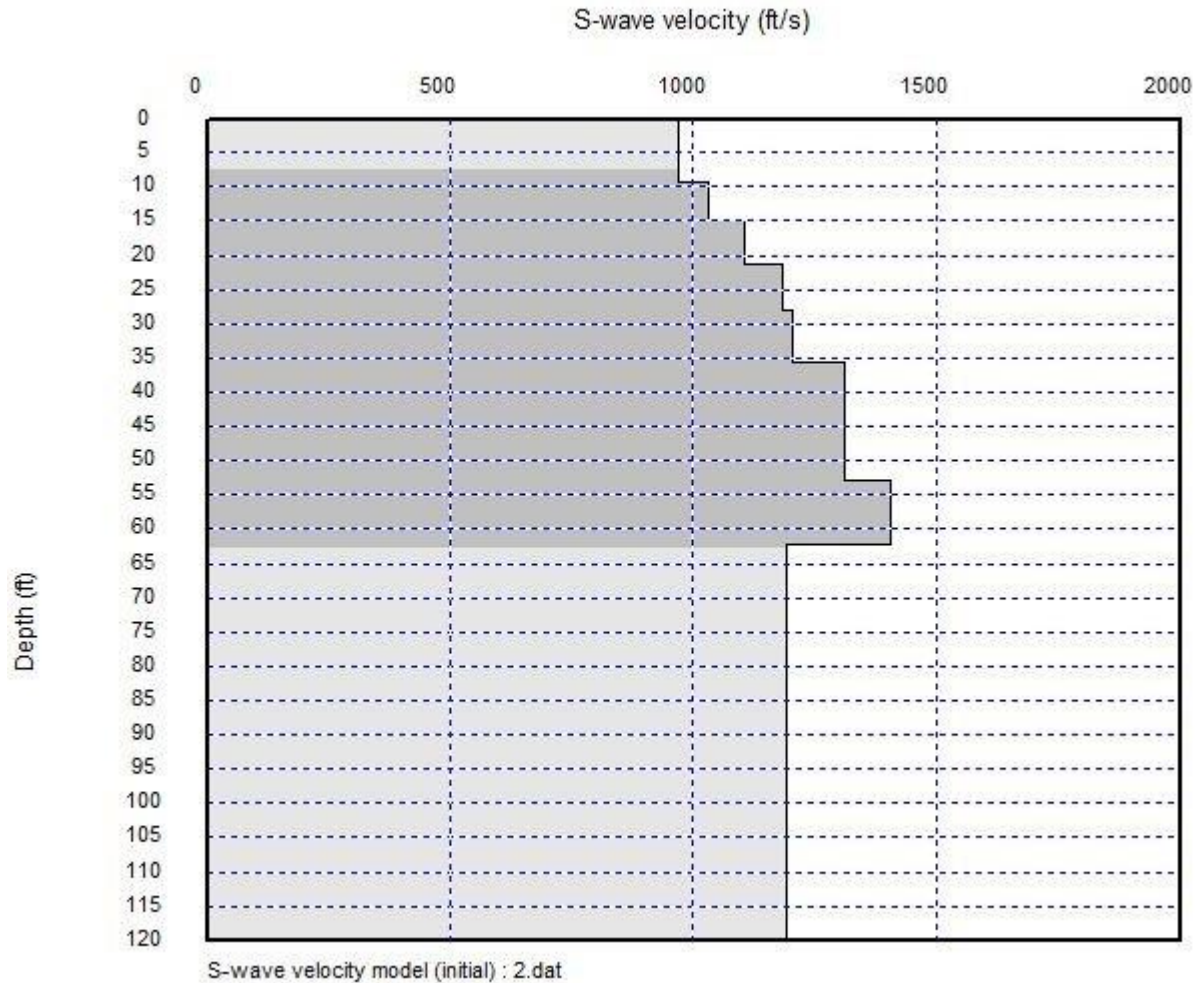

Line B

AVS = 1185.54 ft/s

Site Classification is Class D

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-2

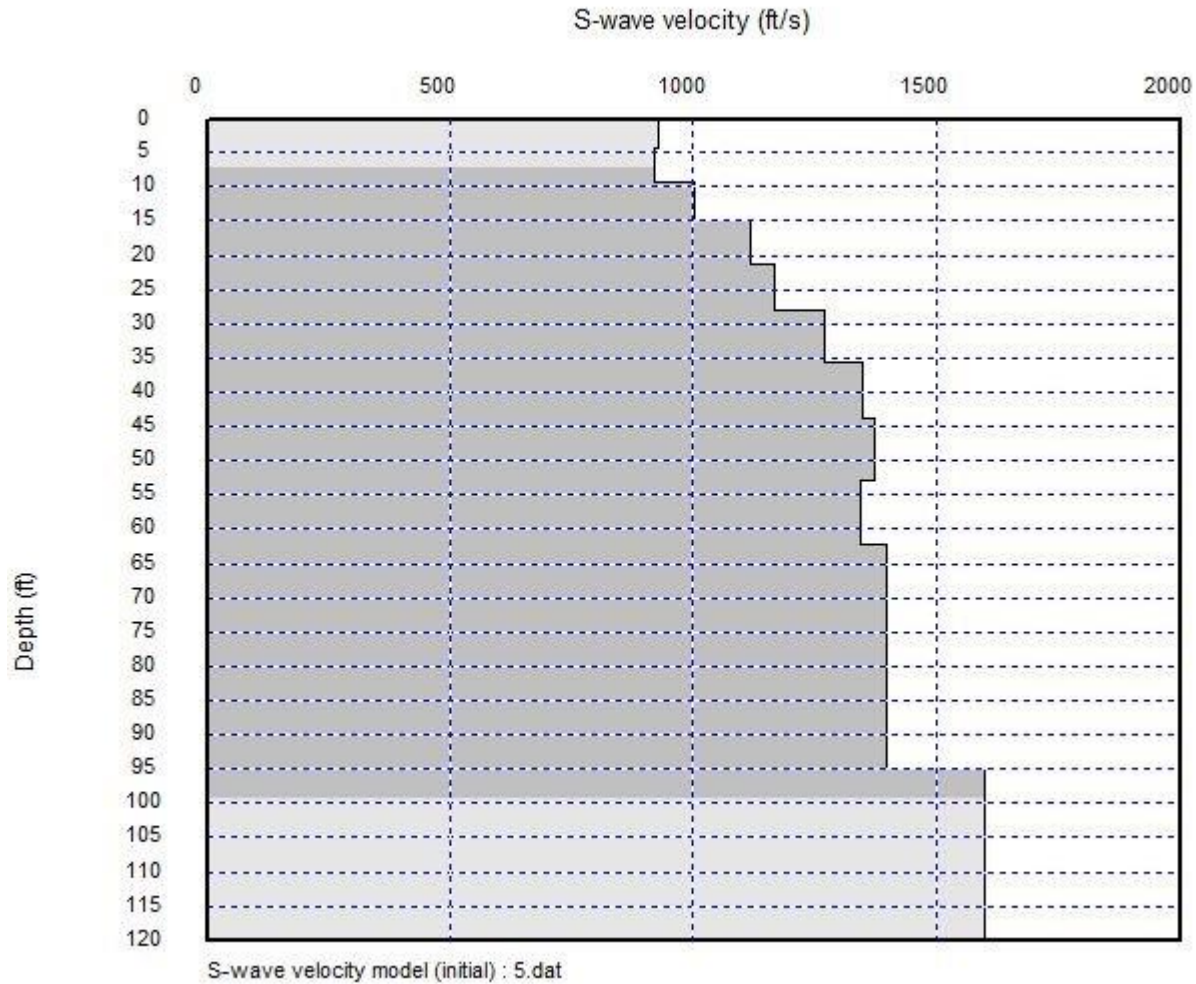

Line C

AVS = 1259.57 ft/s

Site Classification is Class C

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-3

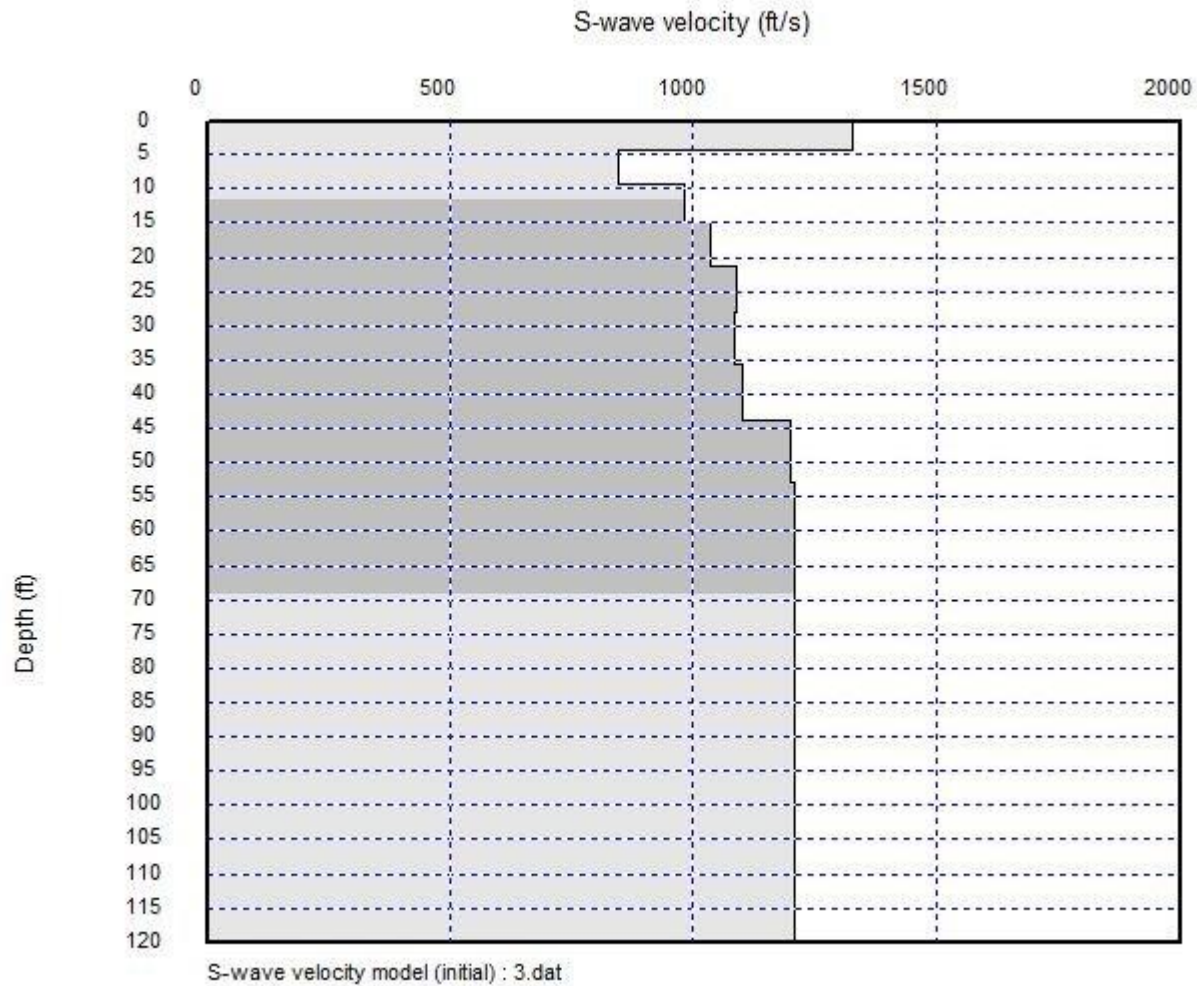

Line D

AVS = 1132.79 ft/s

Site Classification is Class D

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-4

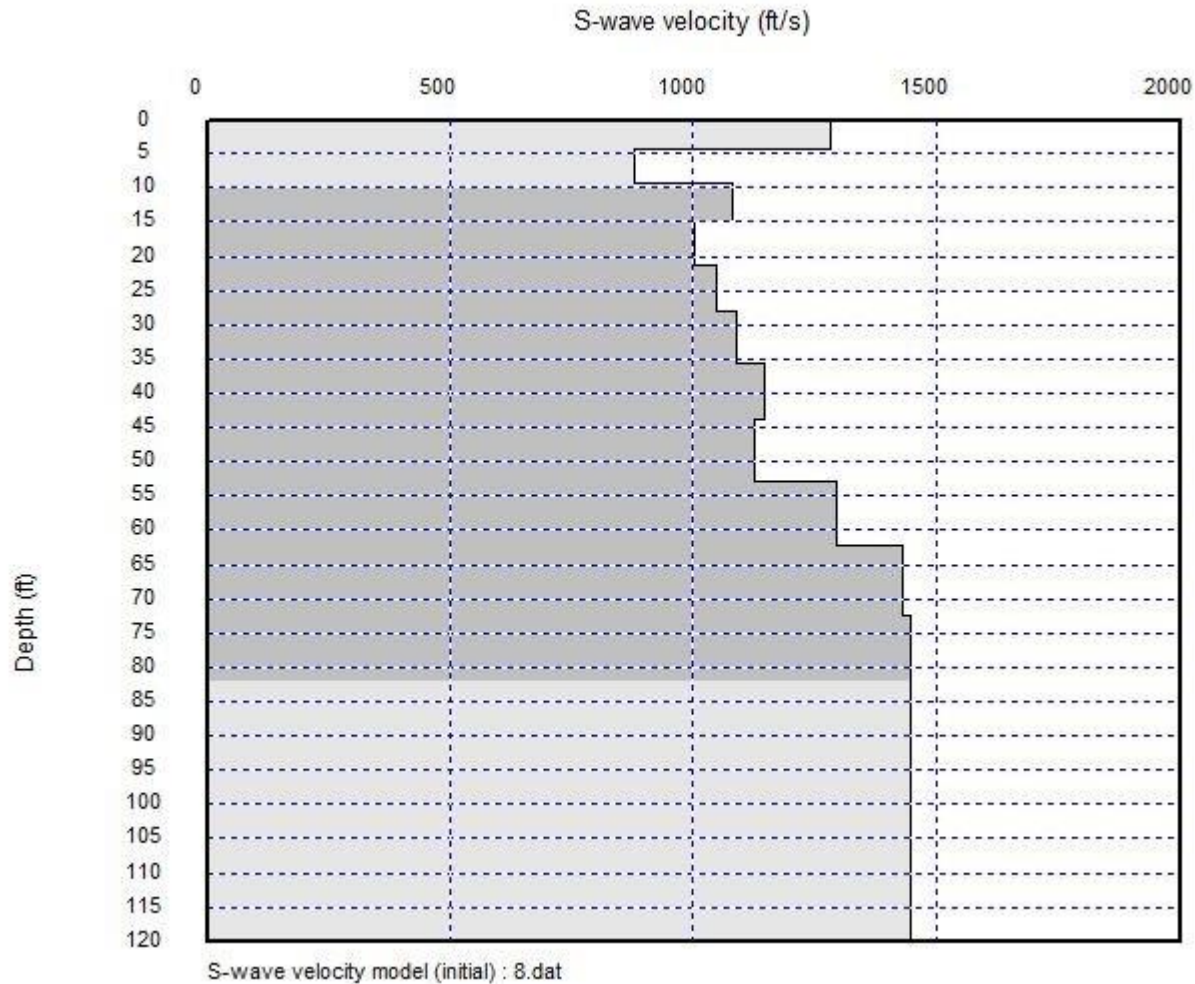

Line E

AVS = 1209.52 ft/s

Site Classification is Class C

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE


C-5

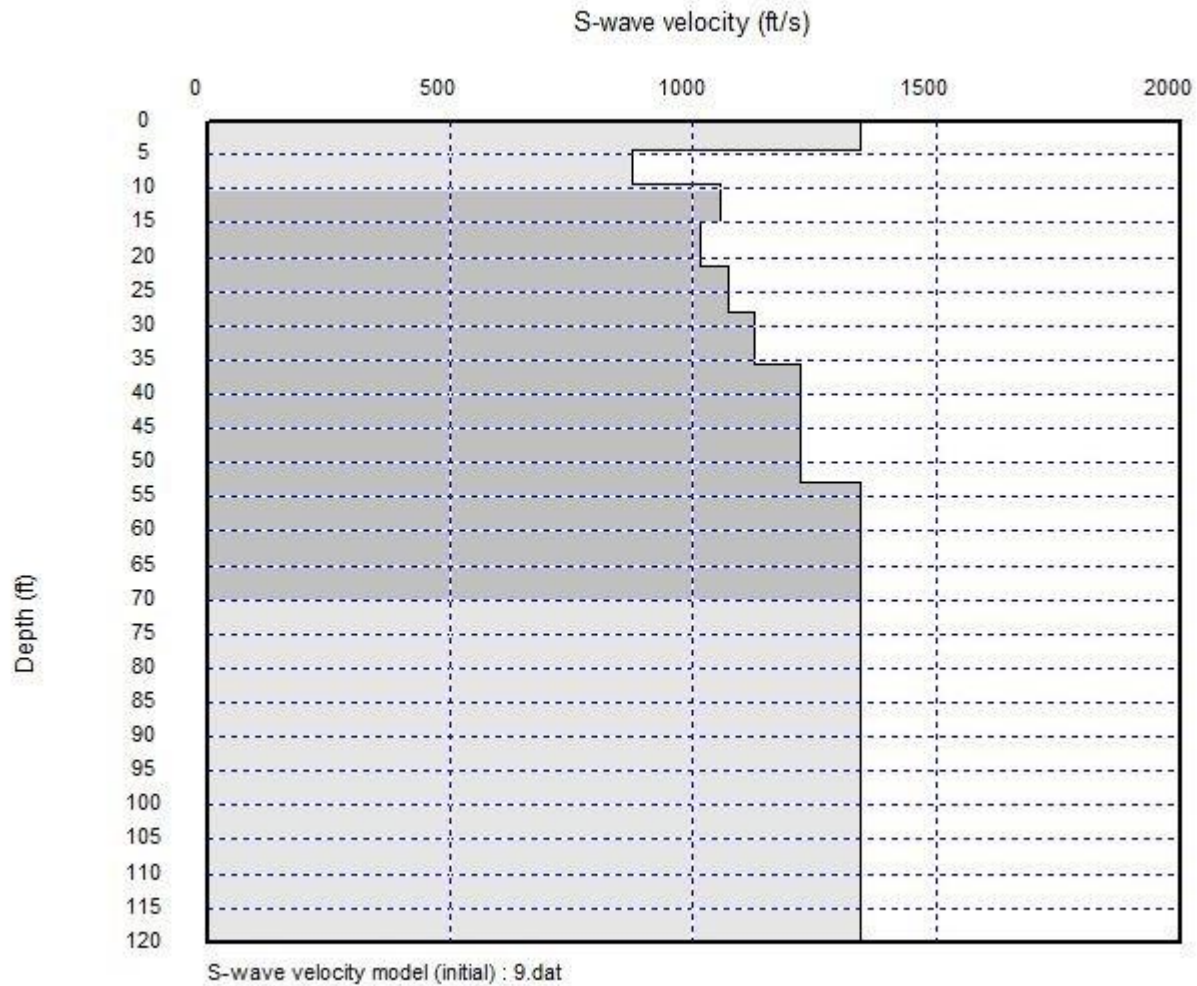

Line F

AVS = 1207.03 ft/s

Site Classification is Class C

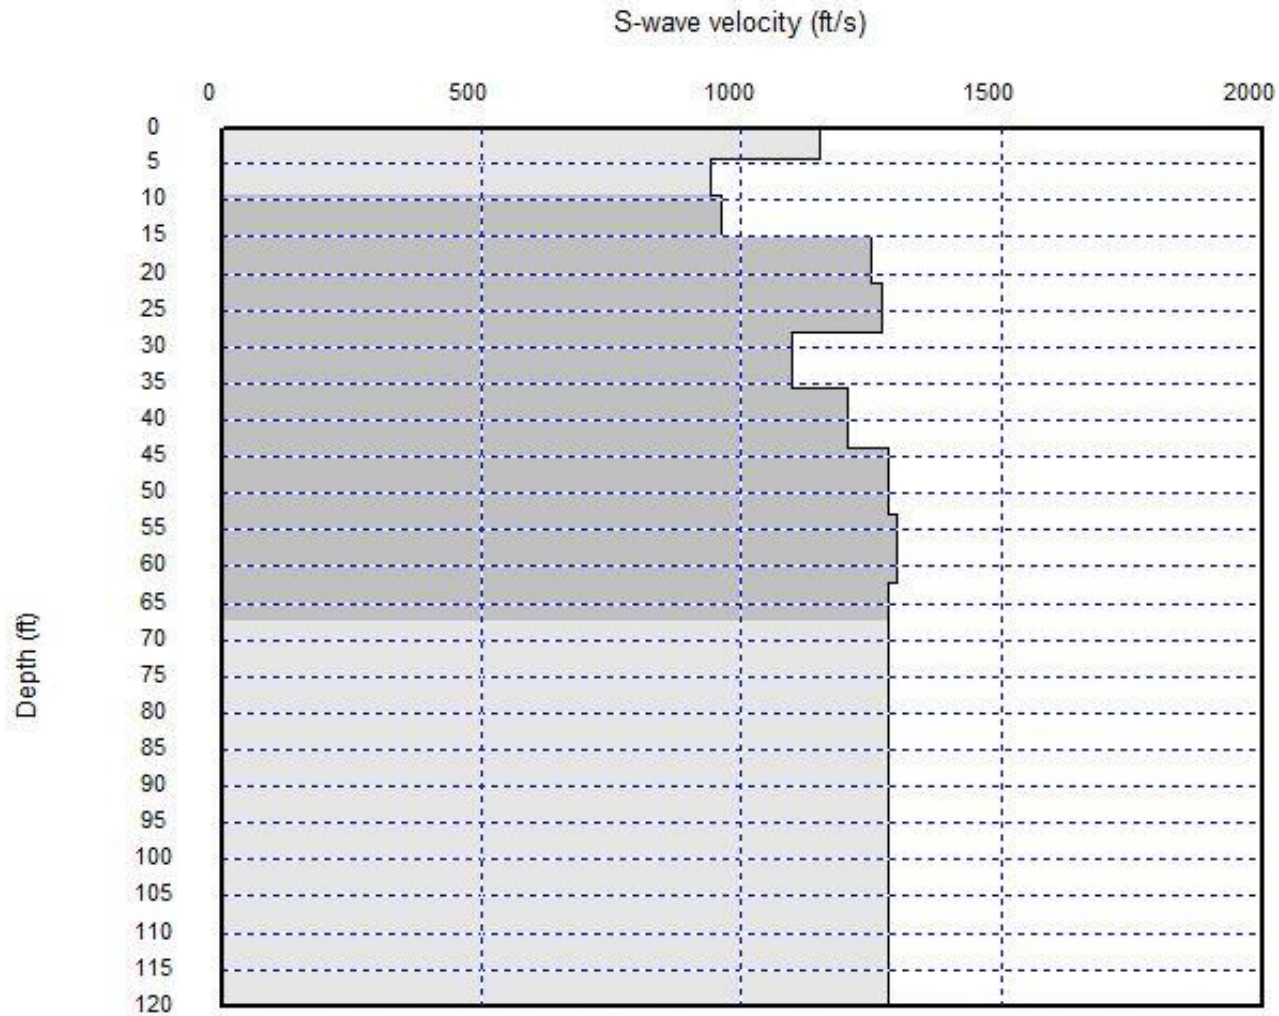

Line G

AVS = 1207.82 ft/s

Site Classification is Class C

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com


PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-7

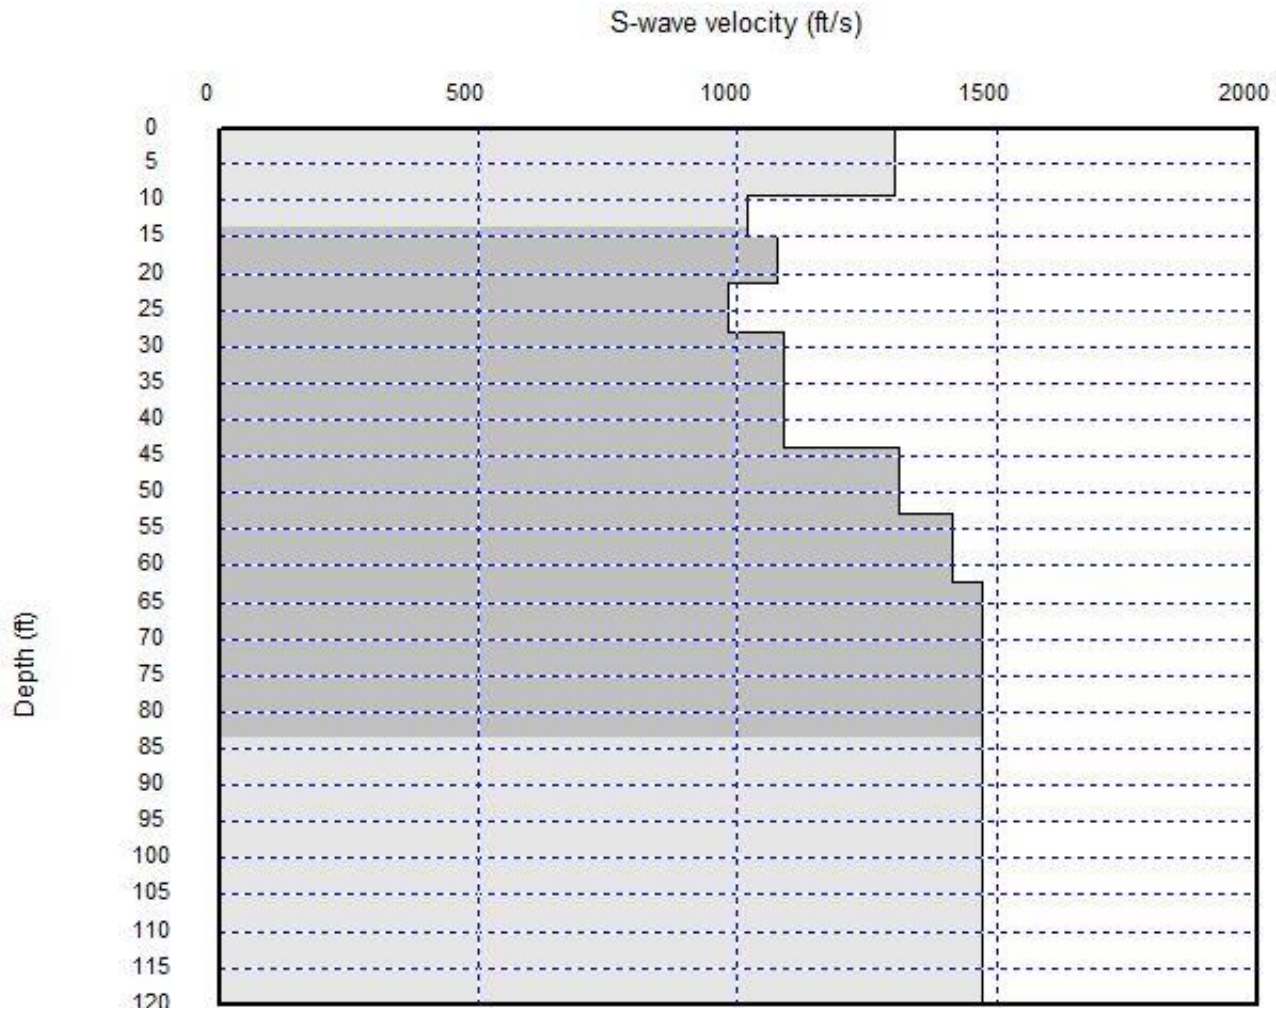

Line H

AVS = 1262.11 ft/s

Site Classification is Class C

Geotechnical
Environmental
Inspections
Materials



**Western
Technologies Inc.**
The Quality People
Since 1955

wt-us.com

PROJECT: Sierra Vista Tracts A, E and F

JOB NO.: 3229JJ104

SHEAR WAVE VELOCITY PROFILE

PLATE

C-8